

DATA SHEET

CO2 CYLINDER BANK SUITABLE FOR 7 CYLINDER WITH RAIL ASSEMBLY

PART NO:
IH030-7S WD

OLD REF NO : 218
DP-5.8/08-022

DATE : JAN 2012

REVISION : 01


SCALE : N.T.S

SHEET : 1 OF 1

APPD. BY: DB

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 60 LITRE /68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.
REV 01:- REV 01 IS SAME AS REV 00 EXCEPT CHANGE IN THE RAIL ASSEMBLY AND ADDING CODE NUMBER.

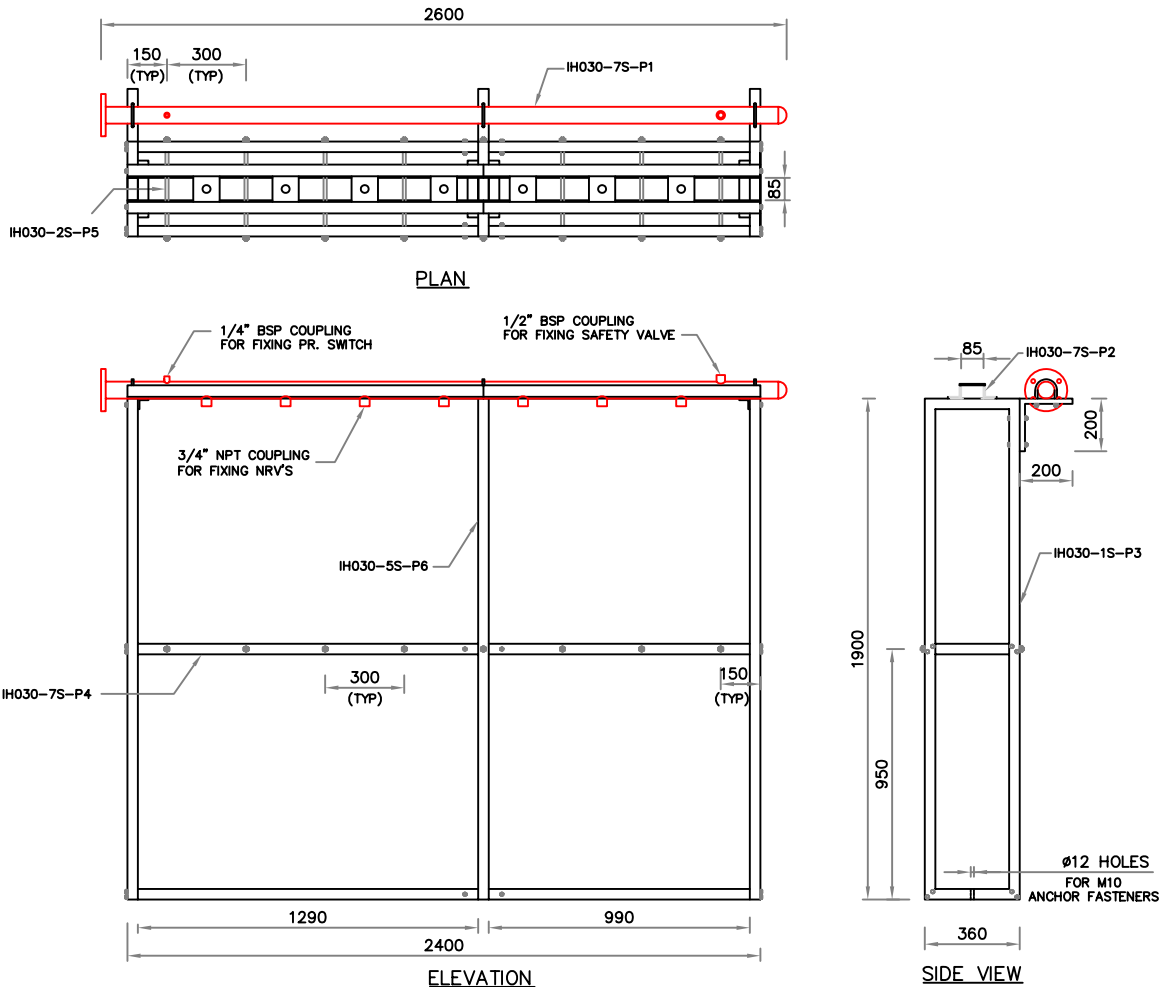

NOTE:

- 01. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
- 02. TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	FRAME (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 40x40x1.6 SQUARE TUBE POWDER COATING – SEIMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	03.	RAIL ASSEMBLY (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	MS 50 x 50 x 6 (L – ANGLE) POWDER COATING – SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE
02.	HEADER (a) MATERIAL OF CONSTRUCTION (b) FINISH (c) TYPE OF CONSTRUCTION	40NB M.S SEAMLESS SCH 80 ASTM A 106 TESTED AT 100 BAR PRESSURE FOR 10 MINUTES POWDER COATING – RED TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	04.	MOUNTING DETAIL	THROUGH BOTTOM FRAME

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.