


DATA SHEET	CO2 CYLINDER BANK SUITABLE FOR 10 CYLINDER WITH RAIL ASSEMBLY				PART NO : IH030-10S WD
	DP-5.8/08-028	DATE : JAN 2012	REVISION : 01	SCALE : N.T.S	SHEET : 1 OF 1

INTRODUCTION :-

TYPICAL CO₂ CYLINDER BANK FRAME ASSEMBLY ARRANGEMENT FOR FIXED INSTALLATION CO₂ FIRE EXTINGUISHER SYSTEM SUITABLE FOR 68 LITRE WATER CAPACITY CYLINDERS OF 267mm DIA MAXIMUM.
REV 01:- REV 01 IS SAME AS REV 00 EXCEPT CHANGE IN THE RAIL ASSEMBLY AND ADDING CODE NUMBER.

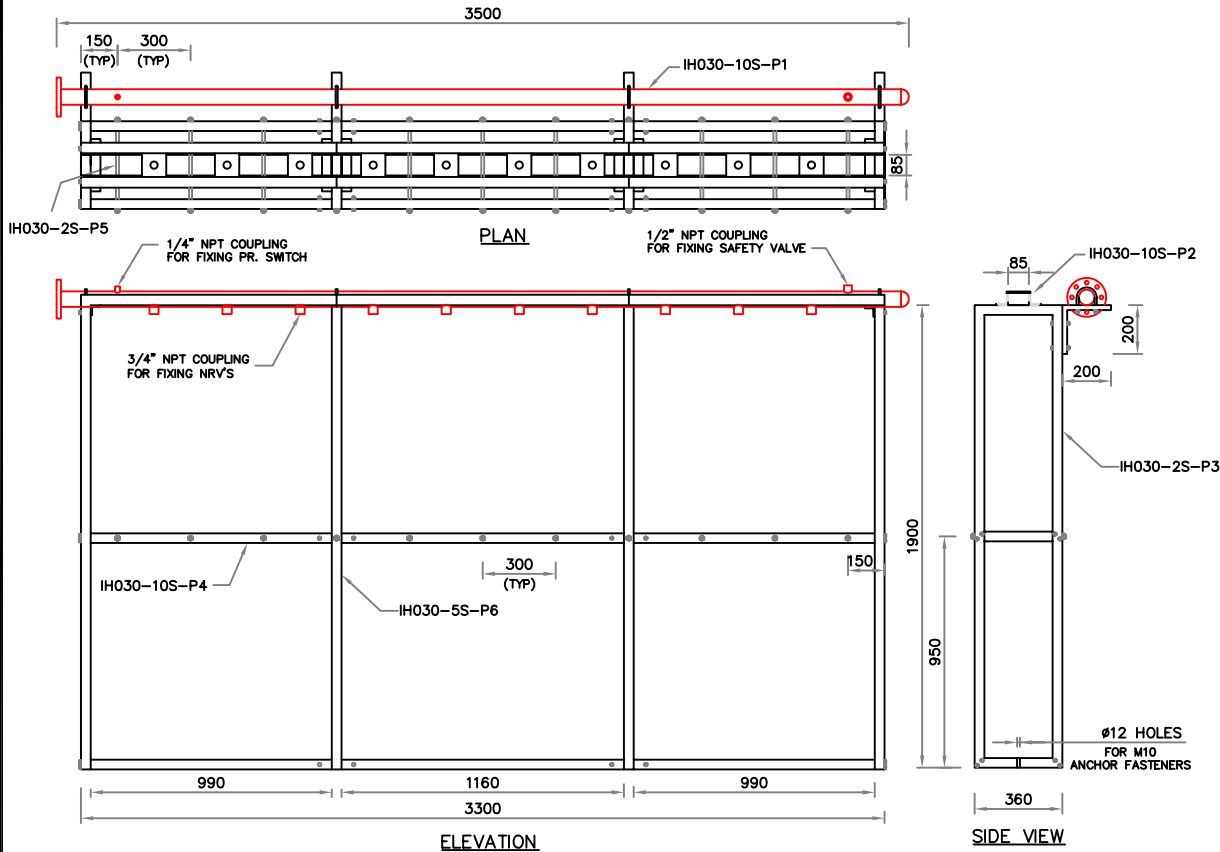

NOTE:

- ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
- TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

TECHNICAL SPECIFICATION

01.	FRAME ASSEMBLY	MS 40x40x1.6 SQUARE TUBE POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	03.	RAIL ASSEMBLY	MS 50 x 50 x 6 (L - ANGLE) POWDER COATING - SIEMENS GRAY TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE THROUGH BOTTOM FRAME
	(a) MATERIAL OF CONSTRUCTION			(a) MATERIAL OF CONSTRUCTION	
02.	HEADER	50NB M.S SEAMLESS SCH 80 ASTM A 106 TESTED AT 100 BAR PRESSURE FOR 10 MINUTES POWDER COATING - RED TEXTURED FIXED WITH S.S. FASTENERS REMOVABLE	04.	MOUNTING DETAIL	
	(a) MATERIAL OF CONSTRUCTION				
	(b) FINISH (c) TYPE OF CONSTRUCTION				

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS / SYSTEM PRESENTED.