

fladet[®] SERIES...

DATA SHEET	IR EMBER DETECTOR WITH AIR PURGING UNIT	PART NO : IH153ES-P-AC/DC
DOC. NO:DP-5.8/MT-433	DATE: APRIL 2022	REVISION :03
	SCALE : N.T.S	SHEET: 1 OF 3
	APPD. BY : DB	

INTRODUCTION :-

IR EMBER DETECTOR WITH IP 67 ENCLOSURE. THE DETECTOR CAN DETECT EMBER. WIDELY RECOMMENDED TO USE IN COAL CONVEYOR PROTECTION.THE DETECTOR CAN BE CONNECTED TO FIRE ALARM PANEL / ANNUNCIATION PANEL / PLC USING SUITABLE POTENTIAL FREE CONTACTS.THE DETECTOR IS PROVIDED WITH SENSITIVITY SELECTION SWITCH.

NOTE: 1.THIS DATASHEET CAN BE ALSO REFERRED AS DOC. NO : DP-5.8/CP-433

2. IH153ES-P-AC/DC - IR EMBER DETECTOR WITH AIR PURGING UNIT CONSIST OF:


- 1.IH153ES-IR EMBER DETECTOR
- 2.IHMB01-XY -SWIVEL MOUNTING BASE
- 3.IH323 AC-DC - AIR PURGING UNIT

REV -01-MAR 2019: REV-01 IS SAME AS REV-00 EXCEPT ADDING ISO 9001:2015.

REV -02-APRIL 2022:CE CERTIFICATE NO. IS UPDATED.

REV -03-APRIL 2022:IHMB01-XY-SWIVEL MOUNTING BASE GENERAL ARRANGEMENT UPDATED.


PART NO : IH153ES - IR EMBER DETECTOR

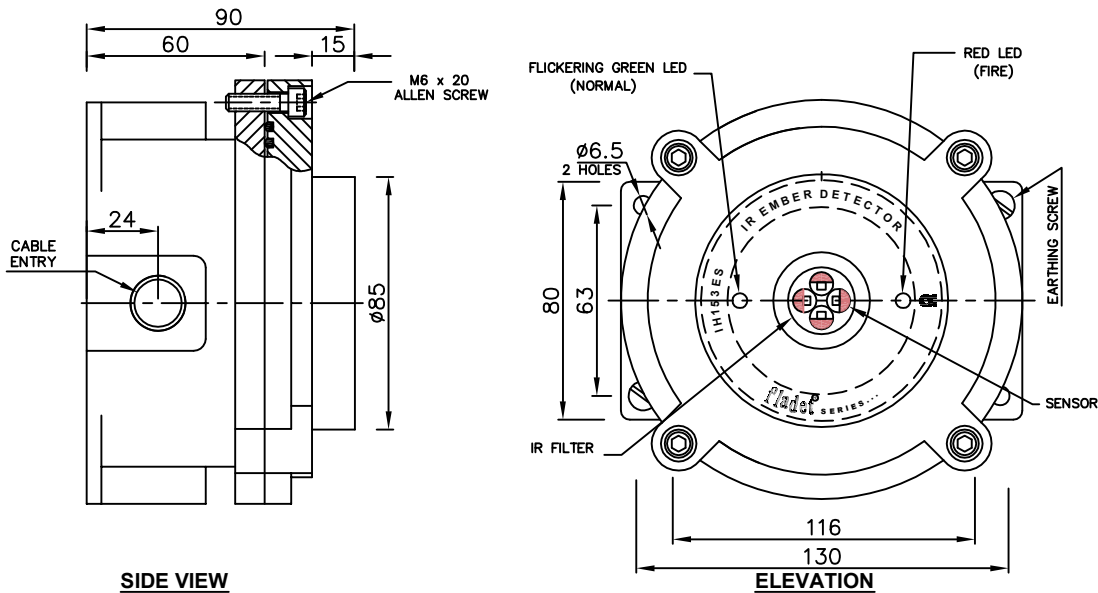

SIDE VIEW

ELEVATION

PART NO : IH323 AC-DC AIR PURGING UNIT

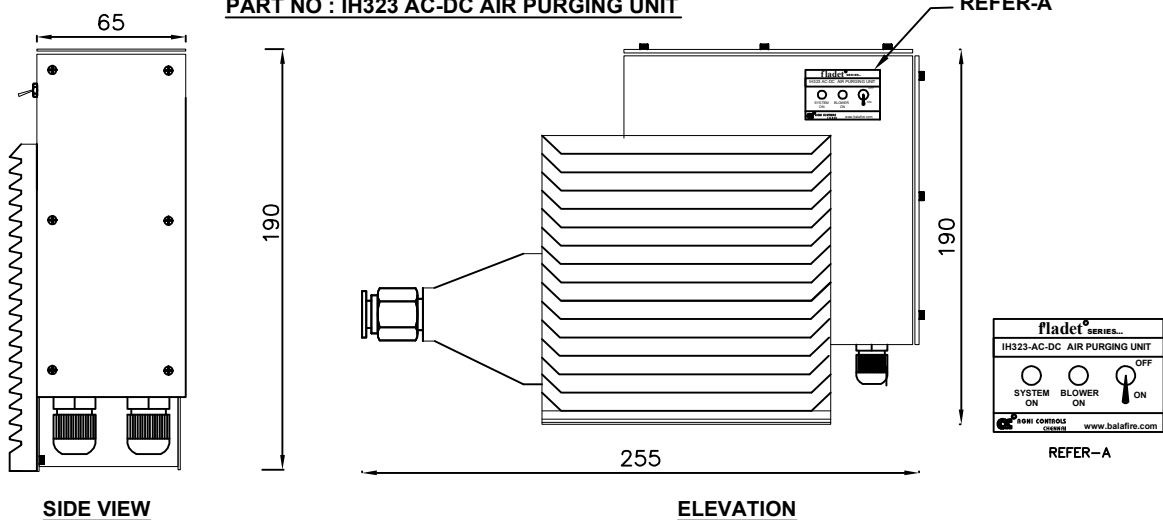

SIDE VIEW

ELEVATION

NOTE:

1. ALL DIMENSIONS ARE IN "mm" UNLESS OTHERWISE SPECIFIED.
2. TOLERANCE ON DIMENSION ± 3 mm, UNLESS OTHERWISE SPECIFIED.

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS/SYSTEM PRESENTED.

AGNI CONTROLS
CHENNAI

NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.

PHONE : +91 44 2481 2420,


E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION


DATA SHEET	IR EMBER DETECTOR WITH AIR PURGING UNIT	PART NO : IH153ES-P-AC/DC
DOC. NO:DP-5.8/MT-433	DATE: APRIL 2022	REVISION :03
	SCALE : N.T.S	SHEET: 2 OF 3
	APPD. BY :DB	

PART NO : IHMB01-XY - SWIVEL MOUNTING BASE

X-AXIS-3 POSITION
Y-AXIS-3 POSITION

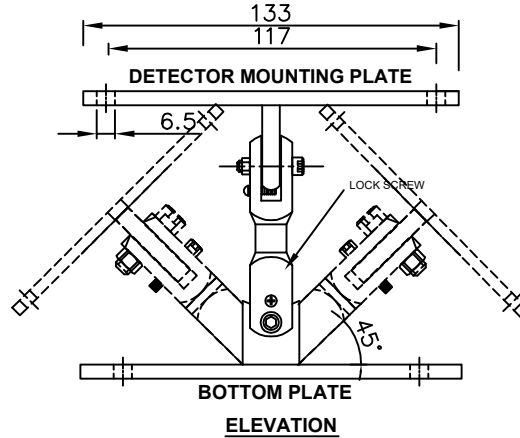

RECOMMENDED MOUNTING ARRANGEMENTS OF DETECTOR & AIR PURGING UNIT

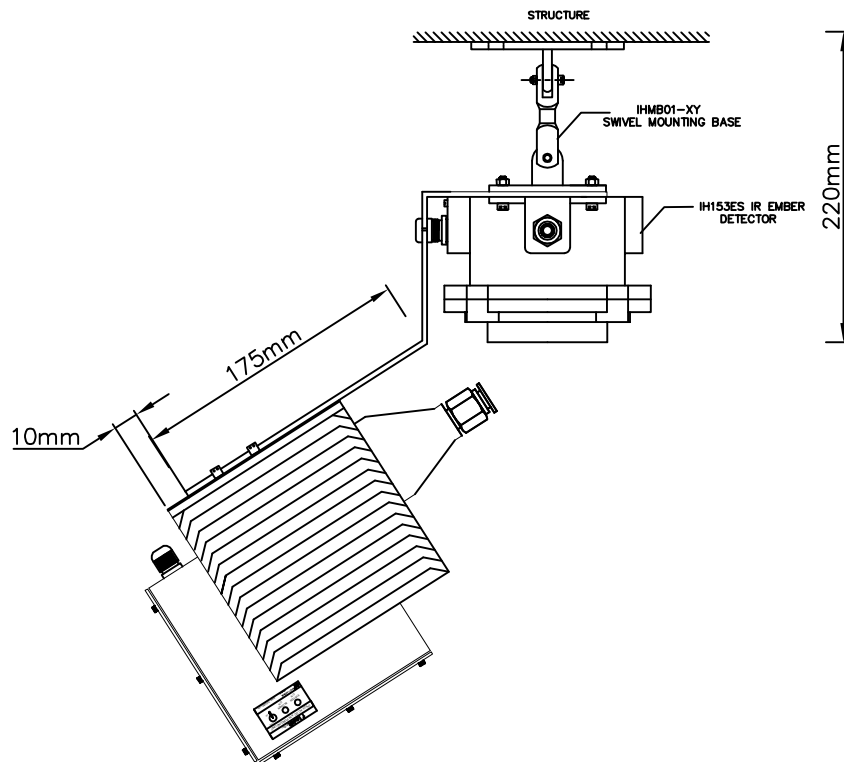

COMMON ACCESSORIES:

1. CODE NO. : IH323 AC-DC-P2-1-600-CONNECTING CABLE 600mm(LENGTH) - 01 NO.
2. CODE NO. : ES04 041 - DUMMY PLUG - 1 NO.
3. CODE NO. : ES04 040 - METAL GLAND M20*1.5mm - 1 NO.
4. CODE NO. : EMS05 070 - M4 X 12 STAR SCREW WITHOUT WASHER - 4 NOS.
5. CODE NO. : EMS05 071 - M6 X 25 ALLEN SCREW - 4 NOS.

NOTE-1: DETECTOR AND AIR PURGING UNIT CAN BE FIXED SEPARATELY ALSO AS PER SITE REQUIREMENT.

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS/SYSTEM PRESENTED.

AGNI CONTROLS
CHENNAI
NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.
PHONE : +91 44 2481 2420,
E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION

DATA SHEET	IR EMBER DETECTOR WITH AIR PURGING UNIT	PART NO : IH153ES-P-AC/DC
DOC. NO: DP-5.8/MT-433	DATE: APRIL 2022	REVISION : 03
	SCALE : N.T.S	SHEET: 3 OF 3
		APPD. BY : DB

NOTE-2: CONNECTING CABLE REQUIREMENT

OPTION-A : IF SYSTEM IS DESIGNED TO OPERATE AIR PURGING UNIT BY 230V AC
IH153ES

- 1) 2X1.5 SQ.MM CABLE FOR 24VDC INPUT SUPPLY
- 2) 2X1.5 SQ.MM CABLE FOR FIRE SIGNAL OUTPUT (OR)
- 4X1.5 SQ.MM CABLE FOR 24VDC INPUT SUPPLY & FIRE SIGNAL OUTPUT.

IH323-AC-DC

- 1) 3X1.5 SQ.MM CABLE FOR 230V AC INPUT SUPPLY (LINE, NEUTRAL AND EARTH)
- 2) 2X1.5 SQ.MM CABLE FOR 230V AC INPUT SUPPLY (LINE, NEUTRAL)
- 1X1.5 SQ.MM CABLE FOR EARTHING.

OPTION-B : IF SYSTEM IS DESIGNED TO OPERATE AIR PURGING UNIT BY 24V DC
IH153ES


- 1) 2X1.5 SQ.MM CABLE FOR 24VDC INPUT SUPPLY
- 2) 2X1.5 SQ.MM CABLE FOR FIRE SIGNAL OUTPUT (OR)
- 4X1.5 SQ.MM CABLE FOR 24V DC INPUT SUPPLY & FIRE SIGNAL OUTPUT.

IH323-AC-DC


- 1) NO EXTRA CABLE IS NEEDED. USE CONNECTING CABLE PROVIDED WITH THE DETECTOR . CONNECT TERMINAL 1&2 OF DETECTOR AND TERMINAL 5&6 OF AIR PURGING UNIT. MAINTAIN THE POLARITY.
 - 2) PLEASE NOTE THAT FIRE CURRENT OF DETECTOR IS 120mA AND AIR PURGING UNIT CURRENT IS 350mA-550mA. POWER REQUIREMENT OF EACH SET WILL BE 24V DC AT 470mA-670mA (MAX).
- WE STRONGLY RECOMMEND TO USE SEPERATE DC POWER SOURCE FOR AIR PURGING UNIT.

WIRING CONNECTION DRAWING OF EMBER DETECTOR & AIR PURGING UNIT

TERMINAL ARRANGEMENT FOR IH153ES

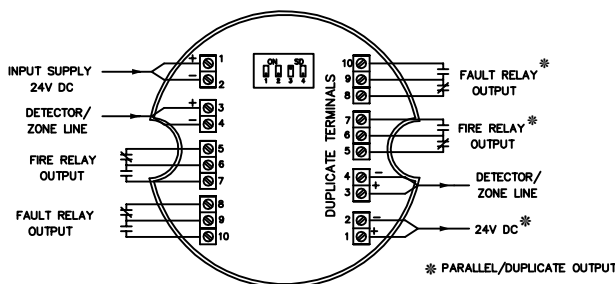

TERMINAL ARRANGEMENT FOR IH323 AC-DC

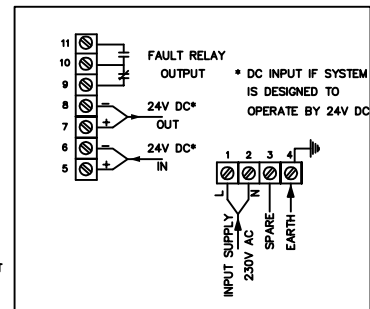

TECHNICAL SPECIFICATION

IH153ES-P-AC/DC - IR EMBER DETECTOR WITH AIR PURGING UNIT CONSIST OF: 1. IH153ES-IR EMBER DETECTOR, 2. IHMB01-XY - SWIVEL MOUNTING BASE, 3. IH323 AC-DC - AIR PURGING UNIT

01.	MANUFACTURER	AGNI CONTROLS - CHENNAI	2.15	SENSITIVITY SELECTION	4 RANGE OF SELECTIONS VERY HIGH SENSITIVITY - 1 HIGH SENSITIVITY - 2 NORMAL SENSITIVITY - 3 (DEFAULT SETTING) LOW SENSITIVITY - 4
02.	IR EMBER DETECTOR	PART NO : IH153ES			
2.1	MATERIAL	CAST ALUMINIUM LM6			
2.2	FINISH	ENCLOSURE- HAMMER TONE GRAY			
2.3	CABLE ENTRY	3/4" ET/ M20X1.5 - 3NOS			
2.4	PROTECTION CLASS	IP 67 FOR DETECTOR			
2.5	SENSING ELEMENT	INFRA RED			
2.6	SPECTRAL FILTER	3000 - 14000 nm			
2.7	EXTERNAL EARTHING	2 Nos.-M6			
2.8	FASTENERS	SS 304			
2.9	OPERATING TEMPERATURE	-20°C TO +60°C			
2.10	SUPPLY	SUPPLY 24V DC ± 20%,			
2.11	QUIESCENT CURRENT	< 40mA			
2.12	ALARM CURRENT	< 120mA			
2.13	DETECTOR SENSITIVITY	100 SQ.CM EMBER @ 1 TO 3 METER IN 90 DEG. CONE ANGLE & STRAIGHT LINE AT NORMAL SENSITIVITY..			
2.14	INDICATION	NORMAL - FLICKERING GREEN LED FIRE - RED LED			
2.15	OUTPUT	IH153ES-APFP 1. ONE SET OF NO-COM-NC CONTACT FOR FIRE PLUS ONE SET OF DUPLICATE NO-COM-NC CONTACT. 2. ONE SET OF NO-COM-NC CONTACT FOR FAULT PLUS ONE SET OF DUPLICATE NO-COM-NC CONTACT. 3. ZONE DETECTOR LINE TO CONNECT DIRECTLY STANDARD CONVENTIONAL FIRE ALARM PANEL.			
			3.	AIR PURGING UNIT	PART NO : IH323 AC-DC 1. VOLTAGE : 230V AC/ 24V DC 2. CURRENT : 10W - 15W 3. SWITCH CONTROL : ON & OFF 4. OPERATION : CONTINUOUS (ON) 5. INDICATION : SYSTEM ON LED-GREEN BLOWER ON LED-YELLOW
			4.	MOUNTING ARRANGEMENT	PART NO : IHMB01-XY MATERIAL OF CONSTRUCTION: M.S PLATE WITH POWDER COATING FASTNERS - SS304 TILTING POSITION X - (-45°)-0-(+45°) Y - (-45°)-0-(+45°)

IMPORTANT:

AGNI CONTROLS RESERVES THE RIGHT TO CHANGE OR MODIFY WITHOUT PREVIOUS NOTICE ANY DATA OR SPECIFICATION DUE TO CHANGES OR MODIFICATION IN ORDER TO IMPROVE THE PRODUCTS/SYSTEM PRESENTED.



AGNI CONTROLS
CHENNAI
NO.1, 6TH STREET, Dr.SUBBARAYAN NAGAR,
KODAMBAKKAM, CHENNAI-600 024, INDIA.
PHONE : +91 44 2481 2420,
E-MAIL : engineering@agnicontrols.com WEBSITE : www.balafire.com

ISO 9001 - 2015
BUREAU VERITAS
CERTIFICATION